

OHA - Drinking Water Services - Surface Water Quality Data Form

County: Lincoln

Cartridge or Bag Filtration

Month/Year: 3-2021


System Name:	Mad Dog Country Tavern		ID#:	41 92052	WTP ID:	TP- A
Day	PSI Before Filter	PSI After Filter	PSID	PSID When to Change Filter	Daily Turbidity Reading [NTU]	Highest Reading of the day ¹ [NTU]
1					21	
2					19	
3					18	
4					22	
5					24	
6					20	
7					20	
8					23	
9					25	
10					21	
11					19	
12					23	
13					20	
14					21	
15					24	
16					20	
17					22	
18					23	
19					25	
20					23	
21					26	
22					23	
23					24	
24					22	
25					20	
26					21	
27					24	
28					23	
29					18	
30					19	
31					17	

Cartridge & Bag Filtration		Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back)	<input checked="" type="radio"/> Yes / <input type="radio"/> No
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	All Cl2 residual at entry point ≥ 0.2 mg/l?	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes: PSI = pounds per square inch
 PSID = pounds per square inch difference (before filter - after filter)
 PSID When to Change Filter = look in manual for manufacturer's specifications when to change the filter, at what PSID.

PRINTED NAME: T.J. Ulsky
 SIGNATURE: *T.J. Ulsky*
 PHONE #: (541) 265-8761
 DATE: 3-31-21
 CERT #:

¹ Including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in Daily Turbidity Reading column may not correspond to continuous readings' maximum.

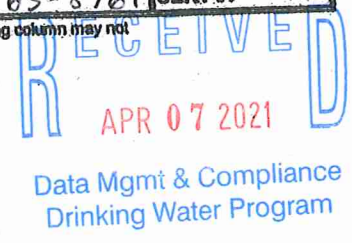

copy

OHA - Drinking Water Services - Surface Water Quality Data Form

A
Disinfection Gardis Log Inactiv:
1

System Name: Mad Dog Country Tavern ID#: 41 92052 Month/Year: MARCH 2021

Date / Time	Minimum Cl ₂ Residual at 1st User (C) ²	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ²	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	1.98	71	198	11.9	72	42	yes	5
2	1.92	71	192	12.9	72	39	yes	5
3	1.95	71	195	12.7	72	39	yes	5
4	1.82	71	182	13.8	72	36	yes	5
5	1.71	71	171	14.7	72	32	yes	5
6	1.54	71	154	14.4	72	31	yes	5
7	1.30	71	130	14.0	72	31	yes	5
8	1.17	71	117	13.4	72	35	yes	5
9	1.23	71	123	12.0	72	37	yes	5
10	1.32	71	132	12.1	72	37	yes	5
11	1.40	71	140	12.3	72	37	yes	5
12	1.64	71	164	12.5	72	38	yes	5
13	1.82	71	182	12.9	72	39	yes	5
14	2.20	71	220	15.0	72	30	yes	5
15	2.28	71	220	13.3	72	36	yes	5
16	2.20	71	220	13.0	72	36	yes	5
17	2.20	71	220	12.9	72	40	yes	5
18	2.20	71	220	13.9	72	36	yes	5
19	2.20	71	220	15.3	72	30	yes	5
20	2.20	71	220	14.9	72	33	yes	5
21	2.20	71	220	14.4	72	33	yes	5
22	2.20	71	220	14.4	72	33	yes	5
23	2.16	71	216	13.5	72	36	yes	5
24	1.85	71	185	13.7	72	36	yes	5
25	1.28	71	128	13.9	72	34	yes	5
26	1.39	71	139	13.9	72	34	yes	5
27	1.68	71	168	14.2	72	32	yes	5
28	2.20	71	220	14.4	72	33	yes	5
29	2.20	71	220	13.3	72	36	yes	5
30	2.20	71	220	14.5	72	33	yes	5
31	2.20	71	220	13.6	72	36	yes	5

² If Cl₂ at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.