

OHA - Drinking Water Services - Surface Water Quality Data Form

County: Lincoln

Cartridge or Bag Filtration


Month/Year: 4-2021

System Name:	Mad Dog Country Tavern		ID#:	41 92052	WTP ID:	TP- A
Day	PSI Before Filter	PSI After Filter	PSID	PSID When to Change Filter	Daily Turbidity Reading [NTU]	Highest Reading of the day <sup>1</sup> [NTU]
1					19	
2					17	
3					20	
4					20	
5					22	
6					18	
7					20	
8					23	
9					24	
10					26	
11					23	
12					22	
13					19	
14					16	
15					17	
16					21	
17					22	
18					20	
19					19	
20					23	
21					24	
22					20	
23					23	
24					21	
25					21	
26					21	
27					23	
28					25	
29					24	
30					22	
31						

<b>Cartridge &amp; Bag Filtration</b>		<b>Monthly Summary (Answer Yes or No)</b>	
95% of daily turbidity readings ≤ 1 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met every day? (see back)	All Cl2 residual at entry point ≥ 0.2 mg/l?
All daily turbidity readings ≤ 5 NTU?	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No	<input checked="" type="radio"/> Yes / <input type="radio"/> No

Notes: PSI = pounds per square inch  
 PSID = pounds per square inch difference (before filter - after filter)  
 PSID When to Change Filter = look in manual for manufacturer's specifications when to change the filter at what PSID.  
<sup>1</sup>including continuous NTU data, if applicable, for optimization recording purposes. Compliance values in Daily Turbidity Reading column may not correspond to continuous readings' maximum.

PRINTED NAME: T.J. UISKY  
 SIGNATURE: *T.J. Uisky*  
 PHONE #: (541) 265-8161  
 DATE: 4-30-21  
 CERT #:

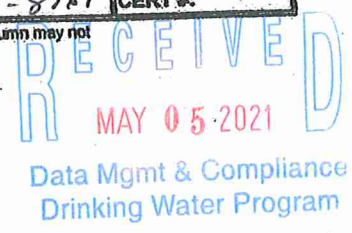

copy

OHA - Drinking Water Services - Surface Water Quality Data Form

System Name: Mad Dog Country Tavern	ID#: 41	92052	Month/Year: April 2021	A	Disinfection Gardias Log Inactiv:	1
-------------------------------------	---------	-------	------------------------	---	---	---

Date / Time	Minimum Cl <sub>2</sub> Residual at 1st User (C) <sup>2</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>2</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	C X T	[° C]		formula	Yes / No	[GPM]
1	2.20	71	220	15.3	72	30	yes	5
2	2.20	71	220	14.3	71	33	yes	5
3	2.20	71	220	14.8	72	33	yes	5
4	2.20	71	220	15.7	72	30	yes	5
5	2.20	71	220	14.6	72	33	yes	5
6	2.20	71	220	13.9	71	36	yes	5
7	2.20	71	220	13.6	72	36	yes	5
8	2.20	71	220	15.1	72	30	yes	5
9	2.01	71	201	14.8	72	33	yes	5
10	1.68	71	168	14.5	72	32	yes	5
11	1.35	71	135	14.2	72	31	yes	5
12	1.47	71	147	14.0	72	31	yes	5
13	1.57	71	157	14.5	72	31	yes	5
14	1.43	71	143	15.0	72	29	yes	5
15	1.45	71	145	15.1	72	29	yes	5
16	1.74	71	174	16.8	72	32	yes	5
17	1.95	71	195	17.7	72	27	yes	5
18	2.20	71	220	17.1	72	27	yes	5
19	2.20	71	220	16.9	72	29	yes	5
20	2.20	71	220	17.5	72	27	yes	5
21	2.20	71	220	16.8	72	29	yes	5
22	2.11	71	211	17.0	72	27	yes	5
23	2.20	71	220	16.6	72	29	yes	5
24	2.07	71	207	16.8	72	29	yes	5
25	1.68	71	168	16.9	72	28	yes	5
26	1.43	71	143	16.7	72	27	yes	5
27	1.21	71	121	16.6	72	27	yes	5
28	1.00	71	100	15.5	72	27	yes	5
29	.87	71	87	17.1	72	24	yes	5
30	.99	71	99	17.5	72	24	yes	5
31								

<sup>2</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l or CT not met, notify DWS within 24 hours.