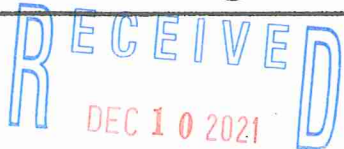



OHA - Drinking Water Services – Turbidity Monitoring Report Form County: Douglas Slow Sand, Membrane, Diatomaceous Earth Filtration or Unfiltered Systems

System Name: Fir Point Bible Conference ID #:OR4192108 WTP:-WTP-A Month/Year: Nov. 21

DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1			System off				
2	↓	↓	↓	↓	↓	↓	↓
3	off	off	.02	off	off	off	.02
4	off	off	.02	off	off	off	.02
5			System off				
6	↓	↓	↓	↓	↓	↓	↓
7	↓	↓	↓	↓	↓	↓	↓
8	↓	↓	↓	↓	↓	↓	↓
9	↓	↓	↓	↓	↓	↓	↓
10	↓	↓	↓	↓	↓	↓	↓
11	↓	↓	↓	↓	↓	↓	↓
12	↓	↓	↓	↓	↓	↓	↓
13	↓	↓	↓	↓	↓	↓	↓
14	↓	↓	↓	↓	↓	↓	↓
15	↓	↓	↓	↓	↓	↓	↓
16	↓	↓	↓	↓	↓	↓	↓
17	↓	↓	↓	↓	↓	↓	↓
18	↓	↓	↓	↓	↓	↓	↓
19	↓	↓	↓	↓	↓	↓	↓
20	↓	↓	↓	↓	↓	↓	↓
21	↓	↓	↓	↓	↓	↓	↓
22	off	off	.01	off	off	off	.01
23	off	off	.02	off	off	off	.02
24	off	off	.01	off	off	off	.01
25			System off				
26	↓	↓	↓	↓	↓	↓	↓
27	↓	↓	↓	↓	↓	↓	↓
28	↓	↓	↓	↓	↓	↓	↓
29	↓	↓	↓	↓	↓	↓	↓
30	↓	↓	↓	↓	↓	↓	↓
31							

Slow Sand/Membrane/DE Filtration/Unfiltered	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ² <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No All daily turbidity readings ≤ 5 NTU? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	CT's met everyday? (see back) <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	All Cl ₂ residual at entry point ≥ 0.2 mg/l? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No
Notes: 	PRINTED NAME: Fred Jensen	
	SIGNATURE: 	DATE: 12-8-21
	PHONE #: (541) 832-2202	CERT #: 0

¹Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. ²Filtered systems only.

Date / Time	Minimum Cl ₂ Residual at User (C)	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	CXT	[°C]		Use tables	Yes / No	[GPM]
1/			System off					
2/	↓	↓	↓	↓	↓	↓	↓	
3/	.37	210	77.7	14.6	7.55	32	yes	
4/	.63	210	132.3	16.4	7.54	28	yes	
5/			System off					
6/	↓	↓	↓	↓	↓	↓	↓	
7/	↓	↓	↓	↓	↓	↓	↓	
8/	↓	↓	↓	↓	↓	↓	↓	
9/	↓	↓	↓	↓	↓	↓	↓	
10/	↓	↓	↓	↓	↓	↓	↓	
11/	↓	↓	↓	↓	↓	↓	↓	
12/	↓	↓	↓	↓	↓	↓	↓	
13/	↓	↓	↓	↓	↓	↓	↓	
14/	↓	↓	↓	↓	↓	↓	↓	
15/	↓	↓	↓	↓	↓	↓	↓	
16/	↓	↓	↓	↓	↓	↓	↓	
17/	↓	↓	↓	↓	↓	↓	↓	
18/	↓	↓	↓	↓	↓	↓	↓	
19/	↓	↓	↓	↓	↓	↓	↓	
20/	↓	↓	↓	↓	↓	↓	↓	
21/	↓	↓	↓	↓	↓	↓	↓	
22/	.46	210	96.6	13.4	7.61	36	yes	
23/	.46	210	96.6	13.6	7.59	35	yes	
24/	.74	210	155.4	13.2	7.54	38	yes	
25/			System off					
26/	↓	↓	↓	↓	↓	↓	↓	
27/	↓	↓	↓	↓	↓	↓	↓	
28/	↓	↓	↓	↓	↓	↓	↓	
29/	↓	↓	↓	↓	↓	↓	↓	
30/	↓	↓	↓	↓	↓	↓	↓	
31/	↓	↓	↓	↓	↓	↓	↓	

³ If Cl₂ at entry point < 0.2 mg/l OR CT not met, notify DWS within 24 hours. Revised October 2013 Download form at: public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf

RECEIVED

10 2021

58
110