

OHA - Drinking Water Services – Turbidity Monitoring Report Form County: Douglas Slow Sand, Membrane, Diatomaceous Earth Filtration or Unfiltered Systems

System Name: Fir Point Bible Conference ID #:OR4192108 WTP:-WTP-A Month/Year: 1-22

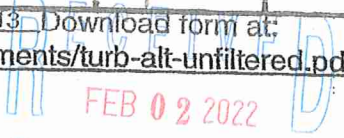
DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1			SYSTEM off				
2							
3							
4							
5							
6							
7							
8							
9							
10	off	off	.01	off	off	off	.01
11	off	off	.02	off	off	off	.02
12	off	off	.02	off	off	off	.02
13			SYSTEM off				
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28	off	off	.02	off	off	off	.02
29	off	off	.02	off	off	off	.02
30			SYSTEM off				
31							

Slow Sand/Membrane/DE Filtration/Unfiltered	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ² <input checked="" type="checkbox"/> Yes / No	CT's met everyday? (see back) <input checked="" type="checkbox"/> Yes / No	All Cl ₂ residual at entry point ≥ 0.2 mg/l? <input checked="" type="checkbox"/> Yes / No
All daily turbidity readings ≤ 5 NTU? <input checked="" type="checkbox"/> Yes / No		
Notes:	PRINTED NAME: Fred Jensen	
	SIGNATURE: <i>[Signature]</i>	DATE: 2-1-22
	PHONE #: 541 832-2202	CERT #: <i>[Signature]</i>

¹Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. ²Filtered systems only.

Date / Time	Minimum Residual at User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	CXT	[°C]		Use tables	Yes / No	[GPM]
1/			System off					
2/								
3/								
4/								
5/								
6/								
7/								
8/								
9/								
10/	.64	210	134.4	10.3	7.43	43	Yes	
11/	.48	210	100.8	9.3	7.62	48	Yes	
12/	.57	210	119.7	8.8	7.52	49	Yes	
13/			System off					
14/								
15/								
16/								
17/								
18/								
19/								
20/								
21/								
22/								
23/								
24/								
25/								
26/								
27/								
28/	.30	210	63	8.4	7.54	49	Yes	
29/	.30	210	63	8.5	7.58	49	Yes	
30/			System off					
31/								

³ If Cl₂ at entry point < 0.2 mg/l OR CT not met, notify DWS within 24 hours. Revised October 2013. Download form at: public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf


 Data Mgmt & Compliance
 Drinking Water Program