


OHA - Drinking Water Services – Turbidity Monitoring Report Form County: Douglas Slow Sand, Membrane, Diatomaceous Earth Filtration or Unfiltered Systems

System Name: Fir Point Bible Conference ID #:OR4192108 WTP:-WTP-A Month/Year: 2-22

DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1			System off				
2	↓	↓	↓	↓	↓	↓	↓
3	↓	↓	↓	↓	↓	↓	↓
4	↓	↓	↓	↓	↓	↓	↓
5	↓	↓	↓	↓	↓	↓	↓
6	↓	↓	↓	↓	↓	↓	↓
7	↓	↓	↓	↓	↓	↓	↓
8	↓	↓	↓	↓	↓	↓	↓
9	↓	↓	↓	↓	↓	↓	↓
10	↓	↓	↓	↓	↓	↓	↓
11	↓	↓	↓	↓	↓	↓	↓
12	↓	↓	↓	↓	↓	↓	↓
13	↓	↓	↓	↓	↓	↓	↓
14	↓	↓	↓	↓	↓	↓	↓
15	↓	↓	↓	↓	↓	↓	↓
16	off	off	.01	off	off	off	.01
17	off	off	.57	off	off	off	.57
18	off	off	.44	off	off	off	.44
19	off	off	.37	off	off	off	.37
20			System off				
21	↓	↓	↓	↓	↓	↓	↓
22	↓	↓	↓	↓	↓	↓	↓
23	↓	↓	↓	↓	↓	↓	↓
24	↓	↓	↓	↓	↓	↓	↓
25	↓	↓	↓	↓	↓	↓	↓
26	↓	↓	↓	↓	↓	↓	↓
27	↓	↓	↓	↓	↓	↓	↓
28	↓	↓	↓	↓	↓	↓	↓
29	-----						
30	-----						
31	-----						

Slow Sand/Membrane/DE Filtration/Unfiltered	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ² <input checked="" type="radio"/> Yes / <input type="radio"/> No All daily turbidity readings ≤ 5 NTU? <input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back) <input checked="" type="radio"/> Yes / <input type="radio"/> No	All Cl ₂ residual at entry point ≥ 0.2 mg/l? <input checked="" type="radio"/> Yes / <input type="radio"/> No
Notes: <i>Began use of sand filter #2 on 2-16-22</i>	PRINTED NAME: <i>Fred Jensen</i>	
<i>Is it operating limits prescribed by LAW</i>	SIGNATURE: <i>[Signature]</i>	DATE: <i>3-1-22</i>
	PHONE #: <i>(541) 832-2202</i>	CERT #: <i>0</i>

¹Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. ²Filtered systems only.

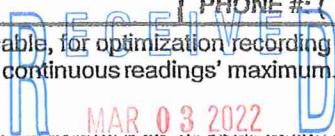

Date / Time	Minimum Cl ₂ Residual at User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	CXT	[°C]		Use tables	Yes / No	[GPM]
1/			SYSTEM off					
2/								
3/								
4/								
5/								
6/								
7/								
8/								
9/								
10/								
11/								
12/								
13/								
14/								
15/								
16/	.37	210	77.7	9.3	7.62	48	yes	
17/	.39	210	81.9	9.6	7.62	48	yes	
18/	.37	210	77.7	9.4	7.48	45	yes	
19/	.61	210	128.1	9.6	7.50	48	yes	
20/			SYSTEM off					
21/								
22/								
23/								
24/								
25/								
26/								
27/								
28/								
29/								
30/								
31/								

³ If Cl₂ at entry point < 0.2 mg/l OR CT not met, notify DWS within 24 hours. Revised October 2013 Download form at: public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf

REVIEWED
MAR 03 2022