


OHA - Drinking Water Services – Turbidity Monitoring Report Form County: Douglas Slow Sand, Membrane, Diatomaceous Earth Filtration or Unfiltered Systems

System Name: Fir Point Bible Conference ID #:OR4192108 WTP:-WTP-A Month/Year: 3-22

DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1			System off				
2							
3							
4							
5							
6							
7							
8	off	off	.02	off	off	off	.02
9	off	off	.02	off	off	off	.02
10	off	off	.02	off	off	off	.02
11	off	off	.02	off	off	off	.02
12			System off				
13							
14							
15							
16	off	off	.02	off	off	off	.02
17	off	off	.01	off	off	off	.01
18			System off				
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							

Slow Sand/Membrane/DE Filtration/Unfiltered	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ² <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No All daily turbidity readings ≤ 5 NTU? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	CT's met everyday? (see back) <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	All Cl ₂ residual at entry point ≥ 0.2 mg/l? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No
Notes: Turbidity Meter CALA broked 3-7-22 OK	PRINTED NAME: Fred Jensen	
	SIGNATURE: <i>[Signature]</i>	DATE: 4-1-22
	PHONE #: (541) 832-2202	CERT #: 0

¹Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. ²Filtered systems only.

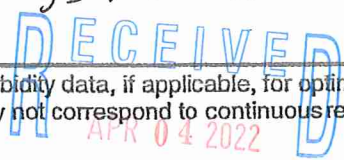

Date / Time	Minimum Cl ₂ Residual at User (C) ³	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	CXT	[°C]		Use tables	Yes / No	[GPM]
1/			System off					
2/	↓	↓	↓	↓	↓	↓	↓	
3/	↓	↓	↓	↓	↓	↓	↓	
4/	↓	↓	↓	↓	↓	↓	↓	
5/	↓	↓	↓	↓	↓	↓	↓	
6/	↓	↓	↓	↓	↓	↓	↓	
7/	↓	↓	↓	↓	↓	↓	↓	
8/	.33	210	69.3	9.8	7.64	48	yes	
9/	.54	210	113.4	9.4	7.57	45	yes	
10/	.48	210	100.8	9.9	7.48	45	yes	
11/	.49	210	102.9	9.8	7.61	48	yes	
12/			System off					
13/	↓	↓	↓	↓	↓	↓	↓	
14/	↓	↓	↓	↓	↓	↓	↓	
15/	↓	↓	↓	↓	↓	↓	↓	
16/	.46	210	96.6	9.6	7.40	45	yes	
17/	.47	210	98.7	9.5	7.51	46	yes	
18/			System off					
19/	↓	↓	↓	↓	↓	↓	↓	
20/	↓	↓	↓	↓	↓	↓	↓	
21/	↓	↓	↓	↓	↓	↓	↓	
22/	↓	↓	↓	↓	↓	↓	↓	
23/	↓	↓	↓	↓	↓	↓	↓	
24/	↓	↓	↓	↓	↓	↓	↓	
25/	↓	↓	↓	↓	↓	↓	↓	
26/	↓	↓	↓	↓	↓	↓	↓	
27/	↓	↓	↓	↓	↓	↓	↓	
28/	↓	↓	↓	↓	↓	↓	↓	
29/	↓	↓	↓	↓	↓	↓	↓	
30/	↓	↓	↓	↓	↓	↓	↓	
31/	↓	↓	↓	↓	↓	↓	↓	

³ If Cl₂ at entry point < 0.2 mg/l OR CT not met, notify DWS within 24 hours. Revised October 2013 Download form at: public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf

RECEIVED
APR 04 2022

Data Mgmt & Compliance
Drinking Water Program