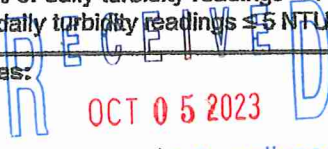




OHA - Drinking Water Services – Turbidity Monitoring Report Form County: Douglas Slow Sand, Membrane Diatomaceous Earth Filtration or Unfiltered Systems

System Name: Fir Point Bible Conference ID #:OR4192108 WTP:-WTP-A Month/Year: 9-23

DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day ¹ [NTU]
1			5.15	Temp off			
2	↓	↓	↓	↓	↓	↓	↓
3	↓	↓	↓	↓	↓	↓	↓
4	↓	↓	↓	↓	↓	↓	↓
5	off	off	.01	off	off	off	.01
6	off	off	.01	off	off	off	.01
7	off	off	.01	off	off	off	.01
8			System off				
9	↓	↓	↓	↓	↓	↓	↓
10	↓	↓	↓	↓	↓	↓	↓
11	↓	↓	↓	↓	↓	↓	↓
12	↓	↓	↓	↓	↓	↓	↓
13	↓	↓	↓	↓	↓	↓	↓
14	↓	↓	↓	↓	↓	↓	↓
15	↓	↓	↓	↓	↓	↓	↓
16	↓	↓	↓	↓	↓	↓	↓
17	↓	↓	↓	↓	↓	↓	↓
18	↓	↓	↓	↓	↓	↓	↓
19	↓	↓	↓	↓	↓	↓	↓
20	off	off	.01	off	off	off	.01
21	off	off	.01	off	off	off	.01
22	off	off	.01	off	off	off	.01
23			System off				
24	↓	↓	↓	↓	↓	↓	↓
25	↓	↓	↓	↓	↓	↓	↓
26	↓	↓	↓	↓	↓	↓	↓
27	↓	↓	↓	↓	↓	↓	↓
28	↓	↓	↓	↓	↓	↓	↓
29	↓	↓	↓	↓	↓	↓	↓
30	↓	↓	↓	↓	↓	↓	↓
31	↓	↓	↓	↓	↓	↓	↓

Slow Sand/Membrane/DE Filtration/Unfiltered	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? ² <input checked="" type="radio"/> Yes / <input type="radio"/> No	CT's met everyday? (see back) <input checked="" type="radio"/> Yes / <input type="radio"/> No	All Cl ₂ residual at entry point ≥ 0.2 mg/l? <input checked="" type="radio"/> Yes / <input type="radio"/> No
All daily turbidity readings ≤ 5 NTU? <input checked="" type="radio"/> Yes / <input type="radio"/> No		
Notes:	PRINTED NAME: Fred Jensen	DATE: 10-1-23
 Data Mgmt & Compliance Drinking Water Program	SIGNATURE: 	CERT #: 
	PHONE #: (541) 832-2202	

¹Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. ²Filtered systems only.

Fir Point Bible Conference

ID #: OR4192108

WTP-: WTP-A

Month/year: 9-23

Date / Time	Minimum Cl ₂ Residual at User (C)	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? ³	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	CXT	[°C]		Use tables	Yes / No	[GPM]
1/			System off					
2/	↓	↓	↓	↓	↓	↓	↓	
3/	↓	↓	↓	↓	↓	↓	↓	
4/	↓	↓	↓	↓	↓	↓	↓	
5/	.34	210	71.4	21.9	7.42	20	yes	
6/	.39	210	81.9	22.1	7.60	20	yes	
7/	.43	210	90.3	23.1	7.61	20	yes	
8/			System off					
9/	↓	↓	↓	↓	↓	↓	↓	
10/	↓	↓	↓	↓	↓	↓	↓	
11/	↓	↓	↓	↓	↓	↓	↓	
12/	↓	↓	↓	↓	↓	↓	↓	
13/	↓	↓	↓	↓	↓	↓	↓	
14/	↓	↓	↓	↓	↓	↓	↓	
15/	↓	↓	↓	↓	↓	↓	↓	
16/	↓	↓	↓	↓	↓	↓	↓	
17/	↓	↓	↓	↓	↓	↓	↓	
18/	↓	↓	↓	↓	↓	↓	↓	
19/	↓	↓	↓	↓	↓	↓	↓	
20/	.36	210	75.6	23.2	7.56	17	yes	
21/	.36	210	75.6	22.6	7.54	19	yes	
22/	.45	210	94.5	20.1	7.45	21	yes	
23/			System off					
24/	↓	↓	↓	↓	↓	↓	↓	
25/	↓	↓	↓	↓	↓	↓	↓	
26/	↓	↓	↓	↓	↓	↓	↓	
27/	↓	↓	↓	↓	↓	↓	↓	
28/	↓	↓	↓	↓	↓	↓	↓	
29/	↓	↓	↓	↓	↓	↓	↓	
30/	↓	↓	↓	↓	↓	↓	↓	
31/								

RECEIVED
 OCT 05 2023
 Data Mgmt & Compliance
 Drinking Water Program

³ If Cl₂ at entry point < 0.2 mg/l OR CT not met, notify DWS within 24 hours. Revised October 2013. Download form at: public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf