


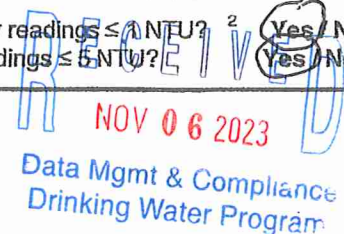

OHA - Drinking Water Services – Turbidity Monitoring Report Form County: Douglas Slow Sand, Membrane, Diatomaceous Earth Filtration or Unfiltered Systems

System Name: Fir Point Bible Conference ID #:OR4192108 WTP:-WTP-A Month/Year: 10-23

DAY	12 AM [NTU]	4 AM [NTU]	8 AM [NTU]	NOON [NTU]	4 PM [NTU]	8 PM [NTU]	Highest Reading of the Day <sup>1</sup> [NTU]
1			SYSTEM off				
2							
3							
4							
5	off	off	.01	off	off	off	.01
6	off	off	.01	off	off	off	.01
7	off	off	.01	off	off	off	.01
8			SYSTEM off				
9							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27	off	off	.01	off	off	off	.01
28	off	off	.01	off	off	off	.01
29	off	off	.01	off	off	off	.01
30			SYSTEM off				
31							

Slow Sand/Membrane/DE Filtration/Unfiltered	Monthly Summary (Answer Yes or No)	
95% of daily turbidity readings ≤ 1 NTU? <sup>2</sup> <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No All daily turbidity readings ≤ 5 NTU? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	CT's met everyday? (see back) <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No	All Cl <sub>2</sub> residual at entry point ≥ 0.2 mg/l? <input checked="" type="checkbox"/> Yes / <input type="checkbox"/> No
Notes: 	PRINTED NAME: Fred Jensen	
	SIGNATURE: 	DATE: 11-1-23
	PHONE #: (541) 832-2202	CERT #: 

<sup>1</sup>Including continuous turbidity data, if applicable, for optimization recording purposes. Compliance values in columns "12 AM" through "8 PM" may not correspond to continuous readings' maximum. <sup>2</sup>Filtered systems only.

Fir Point Bible Conference

ID #: OR4192108

WTP-: WTP-A

Month/year: 10-23

Date / Time	Minimum Cl <sub>2</sub> Residual at User (C) <sup>1,3</sup>	Contact Time (T)	Actual CT	Temp	pH	Required CT	CT Met? <sup>3</sup>	Peak Hourly Demand Flow
	[ppm or mg/L]	[minutes]	CXT	[°C]		Use tables	Yes / No	[GPM]
1/			System off					
2/								
3/								
4/								
5/	.37	210	77.7	18.6	7.54	25	yes	
6/	.37	210	77.7	17.5	7.44	25	yes	
7/	.53	210	111.3	17.6	7.45	25	yes	
8/			System off					
9/								
10/								
11/								
12/								
13/								
14/								
15/								
16/								
17/								
18/								
19/								
20/								
21/								
22/								
23/								
24/								
25/								
26/								
27/	.36	210	75.6	16.2	7.49	29	yes	
28/	.43	210	90.3	15.8	7.52	29	yes	
29/	.46	210	96.6	15.3	7.43	28	yes	
30/			System off					
31/								

<sup>3</sup> If Cl<sub>2</sub> at entry point < 0.2 mg/l OR CT not met, notify DWS within 24 hours. Revised October 2013. Download form at: [public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf](http://public.health.oregon.gov/HealthyEnvironments/DrinkingWater/Monitoring/Documents/turb-alt-unfiltered.pdf)