



January 12, 2021

Brian Wisner, PE
brian@strickerengineering.com
Stricker Engineering
105 East Cypress
Garibaldi, OR 97118

**Re: Arborview Heights Phase 3 – Vine Maple & Salmonberry Ct (PR#189-2020)
Garibaldi Water System (PWS ID#00311)
Conditional Approval**

Dear Mr. Wisner:

On December 31, 2020, our office received a set of plans, land use compatibility statement and a plan review fee of \$3,300 for the *Arborview Heights – Phase 3 Salmonberry Court Extension – Vine Maple and Salmonberry Court* waterline project for the Garibaldi Water System.

The project includes the installation of roughly 350-LF of 4” C900 PVC and roughly 90-ft of 2” PVC Schedule 40 waterline and associated appurtenances to serve 9 single-family homes (Tax Lots 27-34 and Log 18) in the vicinity of Vine Maple Lane and Salmonberry Court in the Arborview Heights residential area of Garibaldi as shown on page 2.

The plans are approved as submitted provided the following condition is met:

- Disinfection of the waterline must be completed according to AWWA C651 and copies of related coliform bacteriological testing are submitted for final approval.


Until we receive verification that the condition above has been met and final approval has been issued, the project is not approved for use. Upon completion of the project, please verify in writing that construction was completed according to the submitted plans. If substantial changes are made, a set of as-built drawings must be submitted. Test results and a *Project Final Approval Request* form (available on-line at:

<https://www.oregon.gov/oha/PH/HEALTHYENVIRONMENTS/DRINKINGWATER/PLANREVIEW/Documents/project-update-form.pdf>) completed to demonstrate conditions were met

should reference Plan Review #189-2020 and e-mailed to me at:

evan.e.hofeld@dhsaha.state.or.us.

Garibaldi Water System (PWS #00311) - Arborview Heights – Phase 3 – Salmonberry Ct Extension
PR #189-2020 – Conditional Approval
January 12, 2021

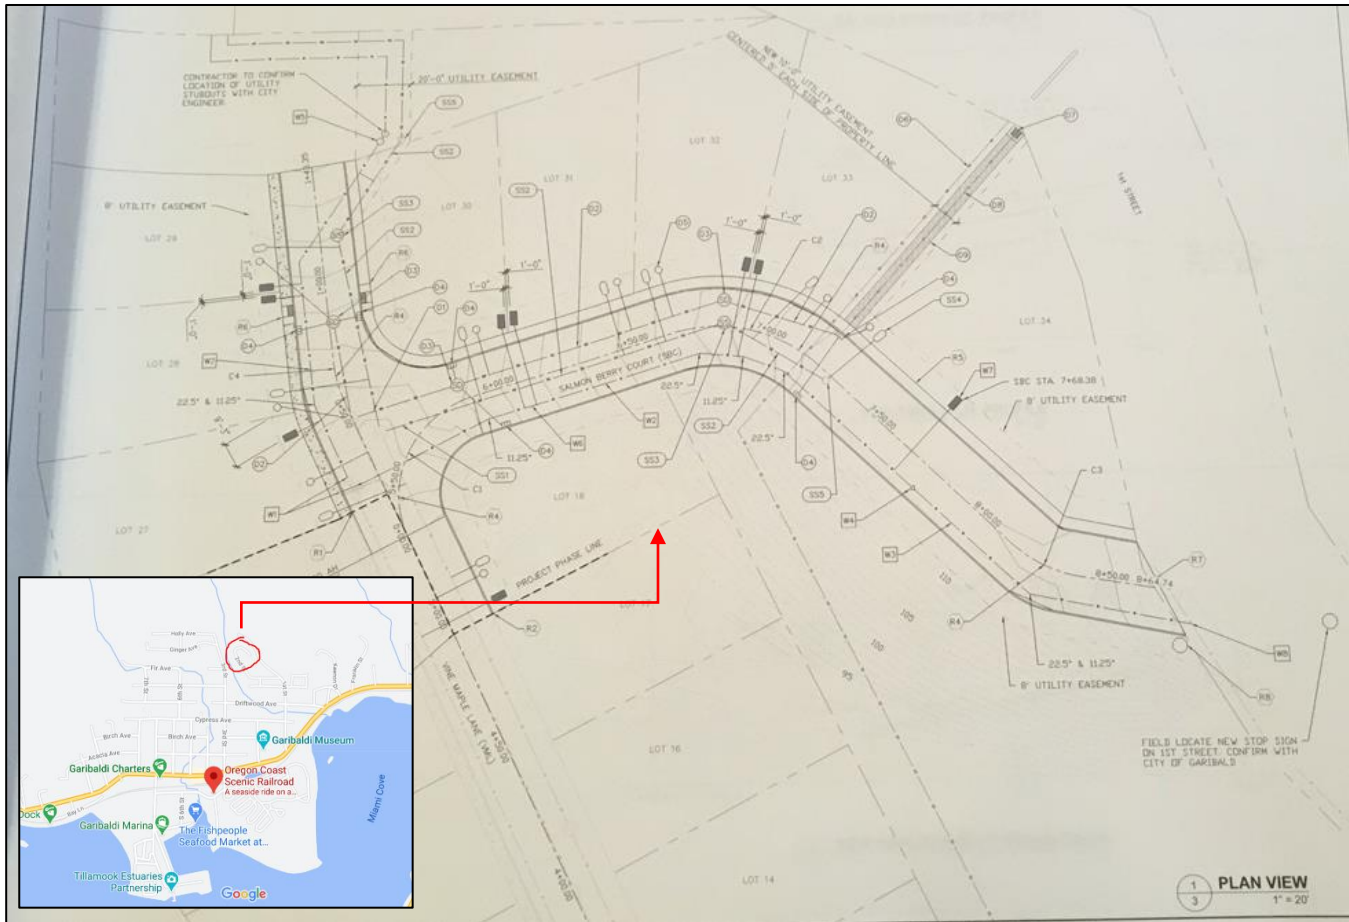

Thank you for your cooperation and patience in completing the review process for this project and if you have any questions, please feel free to contact me at (503) 504-8222 or via e-mail at evan.e.hofeld@state.or.us.

Sincerely,

Evan Hofeld, PE
Regional Engineer
Drinking Water Services

cc: Blake Lettenmaier at Blake@ci.garibaldi.or.us (541-201-8154) – City of Garibaldi
Kelly West at westkellygpw@gmail.com (503-322-0217) – City of Garibaldi
Joseph “Toby” Taylor, JLT Construction, jltconstruction503@gmail.com
Annette Pampush, Tillamook Co Env. Health (apampush@co.tillamook.or.us)