

Cross-Connection Program Enabling Authority

Breitenbush Hot Springs Water System

PWS ID# OR4193461

Date approved: 11/20/12

The purpose of this document is to protect the health of the people served by the Breitenbush Hot Springs Water System by preventing contaminants from flowing backwards into the water supply, and to comply with the onerous and ever-increasing regulatory burden which the Federal and State governments impose despite the fact that no one has ever become sick from drinking Breitenbush water.

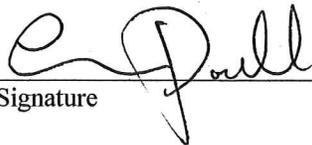
To accomplish this, this document complies with OAR 333-061-0070 through OAR 333-061-0074. This includes installation, maintenance, and testing of backflow prevention devices and assemblies, as well as a burdensome requirement to annually report backflow data to the Oregon Health Authority Drinking Water Program.

Actual cross connections are prohibited. If it is necessary that a potential cross connection exist, then the water system must be protected by an appropriate backflow prevention device or assembly.

All backflow devices and assemblies will be tested: a) upon installation; b) after any backflow incident; c) if the device is moved or repaired; and d) at least yearly. Any device which does not pass a test will be repaired or replaced, then retested. All installation will be done in accordance with the Oregon Plumbing Specialty Code.

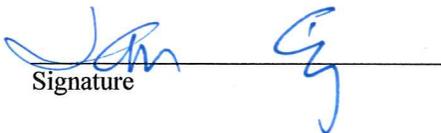
Health hazards, as defined in the above Oregon Administrative Rules and listed in Appendix I, are given the highest priority.

Because the Breitenbush Hot Springs utility systems do not have "customers" in the traditional sense of the word, the responsibility for compliance with the requirements of this authority rests solely with Breitenbush Hot Springs.


Signature

Donest Water Primary
Position

2/24/13
Date


Signature

TEAM COORDINATOR
Position

2/20/13
Date